

Jozef KRIŠ, Ivona ŠKULTÉTYOVÁ

*University of Technology Bratislava,
Faculty of Civil Engineering of the Slovak,
Department of Sanitary and Environmental Engineering*

WATER DISTRIBUTION SYSTEM - THE PRESSURE MANAGEMENT

SYSTEM DOPROWADZENIA WODY — ZARZĄDZANIE CIŚNIENIEM

The article briefly describes pressure conditions in supply and distribution pipes of water supply distribution systems. Moreover, it describes research activities dealing with changes overflow in district meter area (DMA) at the variation of pressure in water supply distribution system. These changes have an impact on water consumption as well as water leakage during the night pressure regulation. Explanation of flow behaviour and water consumption at regulated pressure in the DMA would be a contribution for providers and owners of water supply systems when reducing water losses in water supply distribution systems.

Niniejszy artykuł opisuje pokrótce warunki w zakresie ciśnień w rurach dopływowych oraz doprowadzających w systemach doprowadzania wody. Ponadto opisane zostały działania badawcze w zakresie zmian przepętnień w obszarze wodomierzy okręgowych przy zmianach ciśnienia w systemach doprowadzania wody. Zmiany te mają ogromny wpływ na zużycie wody, jak również na wycieki podczas nocnych regulacji ciśnienia. Wyjaśnienie przepływu oraz zużycia wody przy regulowanym ciśnieniu w obszarze wodomierzy okręgowych stanowiłoby cenne informacje dla dostawców i właścicieli systemów doprowadzania wody w zakresie redukcji ubytków wody.

1. Pressure management

Pressure management can be simply defined as a process of hydraulic pressure maintenance in the optimum range at a desired value. Pressure management is important for reliable and effective water supply and it includes the following:

- ensure of sufficient pressure level in water supply pipes for the need of consumer,
- distribution of water from resource to consumer,

- assure of sufficient pressure for fire protection in the case that water supply is used also for these purposes,
- elimination of impacts of unsteady flow in pipeline.

The pressure in distribution system is determined by water supply components such as:

- water reservoirs,
- pumping stations, automated pumping stations,
- pressure control valves.

The pressure management is done in various ways. In most cases it is related to management of pressure in pressure zones or DMA where appropriate conditions for control of input pressures and discharges are created. The relationship between discharge and pressure is, in fact, the determining factor for the system control and therefore on-line monitoring is an ideal solution that can be applied. Components of pressure management include mostly pumping and regulation points of the system, i.e. automated pumping stations, control valves regulating inlet pressure and stabilization of outlet pressure. For pressure systems and long feeding pipes it is important to prevent the effect of unsteady flow. Elimination these effects can be done by appropriate selection of pipe materials (flexible material absorbing shock waves), proper protection against sudden shutdown or activation of pumps, electric valves, etc.

2. Pressure and water leaks

Water leaks are defined as real water losses that leaked out from pipes, fittings and water supply network installations and they were not used for the purpose of water supply. Real water losses include the following:

- water leaks in bursts of pipes (pipe defects),
- water leaks in bursts of fittings (“flowing” defects of fittings),
- leaks in joints of pipes and fittings,
- leaks at overflow of accumulation reservoirs and water reservoirs.

Water leaks do not include water loss at consumer’s place beyond the point of water consumption metering. Water leaks are associated with the technical conditions of water supply system and they are categorized as follows:

- apparent (leaks are visible on the surface; accidents are accompanied by significant water leaks and they can be detected. Failures are usually reported by residents or operational staff during the check,
- hidden (they are not noticeable on the surface, leaks have long-term effect and they are detected either by coincidence or after longer period when they become apparent).

Apparent failures are usually associated with large single water leak that can be detected. Hidden failures have a long-term effect. They are detected either by coincidence or after longer period when they become apparent. The total time of large apparent (reported) leaks is much shorter than the time of leaks caused by minor failures. Although the leakage at major failures is large, small hidden leaks lead to more significant water losses. The main causes of hidden leaks are failures of service pipes (over 70 % of real losses), failures of sealing material (12 %), defects of fittings (7 %), etc.

The soil, techniques of pipe placing, pipe material and age, pipe joints, water leaks from supply pipes, fittings and service pipes as well as lining, corrosion, water chemis-

try, changes of pressure and work of other involved persons are among the most essential effects causing failures of pipes.

The simplest method for water leakage reduction is the pressure management. It is proved that the pressure reduction in supply system results in decreased rate of flow from existing leaks and reduction of some consumption components. Moreover, it reduces the number of new leaks that occur and it improves the service life of infrastructure.

Foreign literature shows the results of the IWA research (REF. NO.7) verifying the relationship between pressure and rate of leakage. Furthermore, it has been proved that the amount of leaks depends on pressure

$$\frac{L_1}{L_0} = \left(\frac{P_1}{P_0} \right)^{N_1} \quad (1)$$

The relationship describes reduction of pressure from P_0 to P_1 at water leakage changed from L_0 to L_1 . N_1 is an exponent indicating relationship between pressure and leakage.

The pressure ratio (P_1/P_0) is the crucial element of the equation in contrast to the pressure difference. The exponent value has been defined based on night tests at reduced pressure and measurement of inflow and adequate pressure in the zone. The exponent value may vary from 0.5 to 2.5. (REF. NO.7).

For water leaks in flexible pipes: $N_1=0.5$

For water leaks in rigid pipes: $N_1=1.5$

For greater number of tests (loaded by weighted average) the ratio of mean pressure to leakage rate is close to linear dependence ($N_1 = 1$). (REF. NO.7).

Water losses in water supply systems will never be completely eliminated. There exists so-called technical limit of real water losses and it is not possible to reduce real water leaks below this limit. The limit is determined by the UARL parameter (Unavoidable Annual Real Losses). UARL include all kinds of water losses in distribution system in good infrastructure conditions for the system with quickly and effectively repaired leaks and bursts together with intensive active control of water losses.

3. Impact of pressure changes in water distribution system

Decrease or increase of pressure in water supply systems is relatively often repeated phenomenon. Both changes in pressure may have adverse effect on consumer or production processes. Low pressure ratio may lead to insufficient water supply (shutdown of operation, interruption of production processes at low pressure that can be eliminated using booster automated pumping stations). Considerable changes in pressure caused mostly by pressure surge may result in malfunction of appliances and production machines (in case that they are not equipped by safety fittings). Moreover, unexpected changes of pressure in supply system lead to shorter lifetime of pipes and increased frequency of bursts occurrence that is ten times higher than in water supply at the same medial pressure. Pressure management system serves as mechanism for control and regulation of pressure ratios in water supply system. The management system at control points of pressure zones or separately measurable district allows quick response to warnings on minimum pressures that are usually connected with water leaks.

Properly designed and maintained pressure ratios have several advantages:

- reduction of bursts occurrence (3-fold up to 4-fold decrease),

- reliable water supply,
- increased capacity of fire protection,
- longer lifetime of pipes.

4. Water loss control in district meter area

The research and pedagogic activities of the Department of Sanitary and Environmental Engineering include measurement of water pressure and overflow as well as related water leaks in DMA and at that the entire distribution system. Water supply distribution systems in Lučenec have been selected for the purpose of measurement.

4.1. Water loss control in the Lučenec distribution system

For the Lučenec water distribution system with 100 percent share of population supplied with drinking water (27 998 residents), 109,9 km long system of pipes (including 3 411 service supply pipes) and two pressure zones the mathematical model (calibrated and verified) has been developed. The model was also used for dividing of the supply system into 13 DMA. These DMA are using currently (see the next picture).

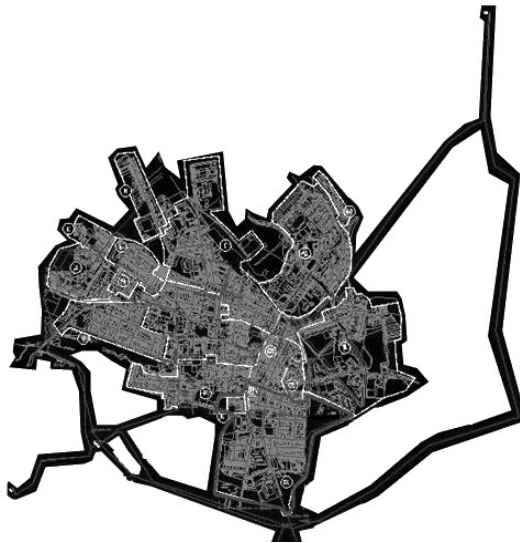


Fig. 1 Distribution System of the Town of Lučenec with District Meter Area

Rys. 1. System doprowadzenia wody w mieście Lučenec w obszarze wodomierzy okręgowych

After consultation with the provider of distribution system three districts D_1 , D_2 and E were selected. These districts are marked with a red line in figure 1. For the purpose of measurement it was necessary to reconstruct the shaft no. 12 because of installing the pressure reducing valve (see the figure 2).



Fig. 2 Control shaft no. 12

Rys. 2. Wał sterujący nr 12

After reconstruction the shaft was connected to dispatching centre using remote control. Another requirement was to close the stop valves U-D1, U-D2, U-D3, U-D4 a U-D5 (see the picture 3). Moreover, it was necessary to install data loggers in the shafts no. 7 and 11 to record pressure and inflow to the districts D_1 and D_2 .

5. Measuring and calculation

Measuring procedure is based on the pressure regulation in a given pressure zone using pressure reducing valve to reduce the pressure from 0.55 MPa down to 0.45 MPa, 0.40 MPa and 0.35 MPa. The values of pressure and inflow are recorded within the measurable districts. From the measured values only data of night flow with the maximum pressure in distribution system at desired setting of pressure reducing valve are used.

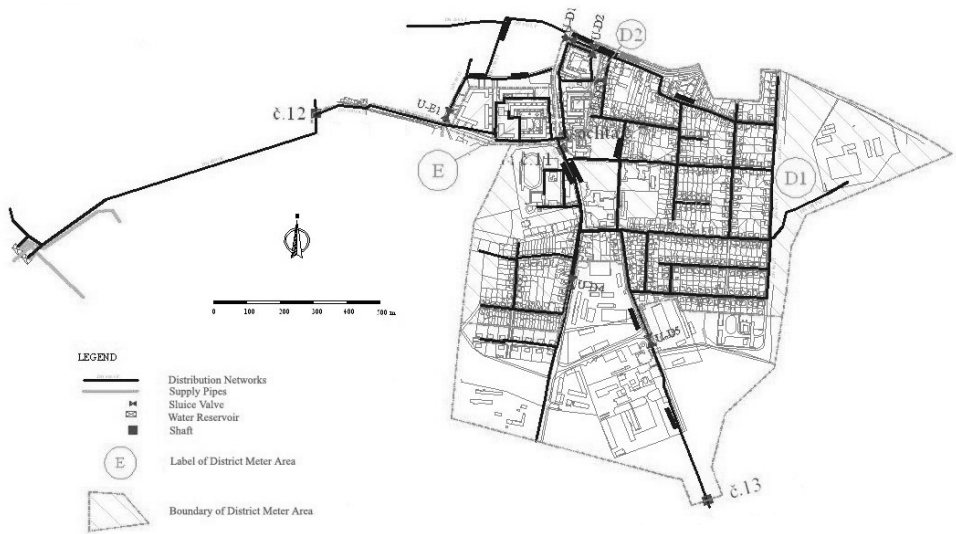


Fig. 3 District Meter Areas D_1 , D_2 and E

Rys. 3. Obszary wodomierzy okręgowych D_1 , D_2 oraz E

After calculation of the leakage exponent from measured values the results were verified also by the mathematical model using Mike Net software tool.

6. Measuring and calculation

Measuring procedure is based on the pressure regulation in a given pressure zone using pressure reducing valve to reduce the pressure from 0.55 MPa down to 0.45 MPa, 0.40 MPa and 0.35 MPa. The values of pressure and inflow are recorded within the measurable districts. From the measured values only data of night flow with the maximum pressure in distribution system at desired setting of pressure reducing valve are used.

After calculation of the leakage exponent from measured values the results were verified also by the mathematical model using Mike Net software tool.

7. Conclusion

The results of the research verified the values of leakage exponent published by J. Thornton and M. Farlay also in our operational conditions. The values of leakage exponent were ranged from 0.3 up to 1.5. In the following tables we can see that the values of leakage exponent are slightly lower compared to the values verified in mathematical model.

Tab. 1. Values of leakage exponent from measured values for the districts D_1 and D_2 Tab. 1. Wartości współczynnika nieszczelności ze zmierzonych wartości dla okręgów D_1 i D_2

DMA Together		DMA D_1		DMA D_2	
P_1/P_0	N_1	P_1/P_0	N_1	P_1/P_0	N_1
[-]	[-]	[-]	[-]	[-]	[-]
1,01	0,1	1,00	0,0	0,96	-0,3
1,20	0,3	1,22	0,4	1,02	0,3
1,15	0,3	1,16	0,4	1,28	0,6
1,04	0,4	1,05	0,5	1,36	0,7
1,19	0,5	1,23	0,5	1,33	0,8
1,60	0,5	1,22	0,6	1,83	0,9
1,14	0,5	1,50	0,6	1,78	0,9
1,54	0,5	1,43	0,6	1,34	1,1
1,35	0,5	1,16	0,7	1,42	1,2
1,33	0,7	1,23	0,8	1,39	1,5

Tab. 2. Verified values of leakage exponent from mathematical model for the district D_1 Tab. 2. Potwierdzone wartości współczynnika nieszczelności z matematycznego modelu dla okręgu D_1

DMA D_1					
P_1/P_0	N_1	P_1/P_0	N_1	P_1/P_0	N_1
[-]	[-]	[-]	[-]	[-]	[-]
1,1	0,6	1,2	0,5	1,4	0,6
1,1	0,4	1,2	0,4	1,4	0,4
1,1	0,5	1,2	0,5	1,3	0,5
1,1	0,4	1,2	0,5	1,4	0,5
1,1	0,5	1,2	0,6	1,4	0,6
1,2	0,4	1,3	0,5	1,5	0,5
1,2	0,3	1,3	0,3	1,6	0,3
1,1	0,6	1,2	0,4	1,4	0,5
1,1	0,5	1,2	0,5	1,4	0,5
1,1	0,4	1,2	0,4	1,4	0,4
1,1	0,4	1,2	0,4	1,4	0,4
1,1	0,4	1,2	0,4	1,4	0,4

This phenomenon is caused by the factors having an effect on leakage exponent. This effect does not occur in the mathematical model. The factors having an effect on the leakage exponent are as follows:

- leak hydraulics
- pipe material behavior
- soil hydraulics
- water demand

The most recent research in the UK recommends using a power law relationship with:

- linear pressure: leaks relationship in large zones and undertaking-wide assessment, or where no other evidences exists and high precision of results is not a priority,

- different powers at different leakage levels, for smaller zones, or where more precision is required,
- individual measurements of the pressure-flow relationship should be made where the precise relationship is critical.

This paper is supported by the VEGA 1/0854/08, 1/3313/06 and KEGA 3/5125/07 Grant Research Project dealt with at the Department of Sanitary and Environmental Engineering of the Faculty of Civil engineering of the Slovak University of Technology in Bratislava.

References

- [1] EN 805, STN 75 5403 Water Supply Engineering – Requirements on Water Supply Systems and Equipment out of Buildings
- [2] Gullick R., Lechevalier M., Case J., Wood D., Funk J., Friedman M. Application of Pressure Monitoring Modeling to Detect and Minimize Low Pressure Event in Distribution System, JWS: Research and Technology – AQUA, IWA Publishing 2005
- [3] Kriš et al. Water Supply Publisher – Slovak University of Technology Bratislava 2006, ISBN 80-227-2426-2
- [4] Kriš, J., Faško, M.: The pressure effect to water flow within water distribution system. In: *Water Management and Hydraulic Engineering : Proceedings of 10th International symposium./Croatia, Šibenik, 4.-9.9.2007.* - Zagreb: Faculty of Civil Engineering, 2007. - ISBN 978-953-6272-22-8. - p. 37
- [5] Kriš, J., Faško, M.: Reduction of Drinking Water Losses in the Town of Poltár: TOM 2. In: *Zaopatrzenie w wodę, jakość i ochrona wód. Water supply and water quality. Tom II. : XIX-th National, VII-th International scientific and technical conference./Zakopane, Poland, 18.-21.6.2006.* - ISBN 83-60055-14-9. - p. 511-518
- [6] STS 75 5401 Design of Water Supply Pipes
- [7] Thornton J., Lambert A. Progress in practical prediction of pressure: leakage, pressure: burst frequency and pressure: consumption relationships, *Conference of IWA Water Loss Task force – Leakage 2005*, Halifax, Nova Scotia, Canada, 2005
- [8] Tóthová, K., Barloková, D., Dubová, V. Risk Analyses of Water Supplies. In: *Proceedings of International Conference on Drinking Water 2006*, June 2006, Tábor, pp. 25-30
- [9] Tóthová, K., Dubová, V., Barloková, D. Benchmarking of Water Supply Systems Focused on Water Losses. In: *Acta Mechanica Slovaca*, 2-B/2005, Vol. IX., ISSN 1335-2393, pp. 141-146
- [10] Tóthová, K., Stanko, Š.: Sustainable Growing up of Water Supply and Waste Water Sewerage in SR. In: *10th international symposium Water Management and Hydraulic Engineering : Proceedings of 10th International symposium. Croatia, Šibenik, 4.-9.9.2007.* - Zagreb : Faculty of Civil Engineering, 2007. - ISBN 978-953-6272-21-1. – CD

-
- [11] Tóthová, K., Stanko, Š.: Tools for achieving the equilibrium in water supply and waste water sewerage in Slovak Republic. In: *Leading-Edge Asset Management Report and abstract book & CD. LESAM 2007 : 2nd Leading Edge Conference on Strategic Asset Mangement/Reports and Abstract Book/Portugal*, Lisabon, 17.-19.10.2007. - Lisabon : IWA, 2007. - CD
- [12] Trow S, Farlay M. Developing a Strategy for Leakage Management in Water Distribution System, *Water Science and Technology, Water Supply*. Vol. 4, No 2, 2004

